

- ☐ end station without management controller
- ☒ end station with management controller

FIG. 1

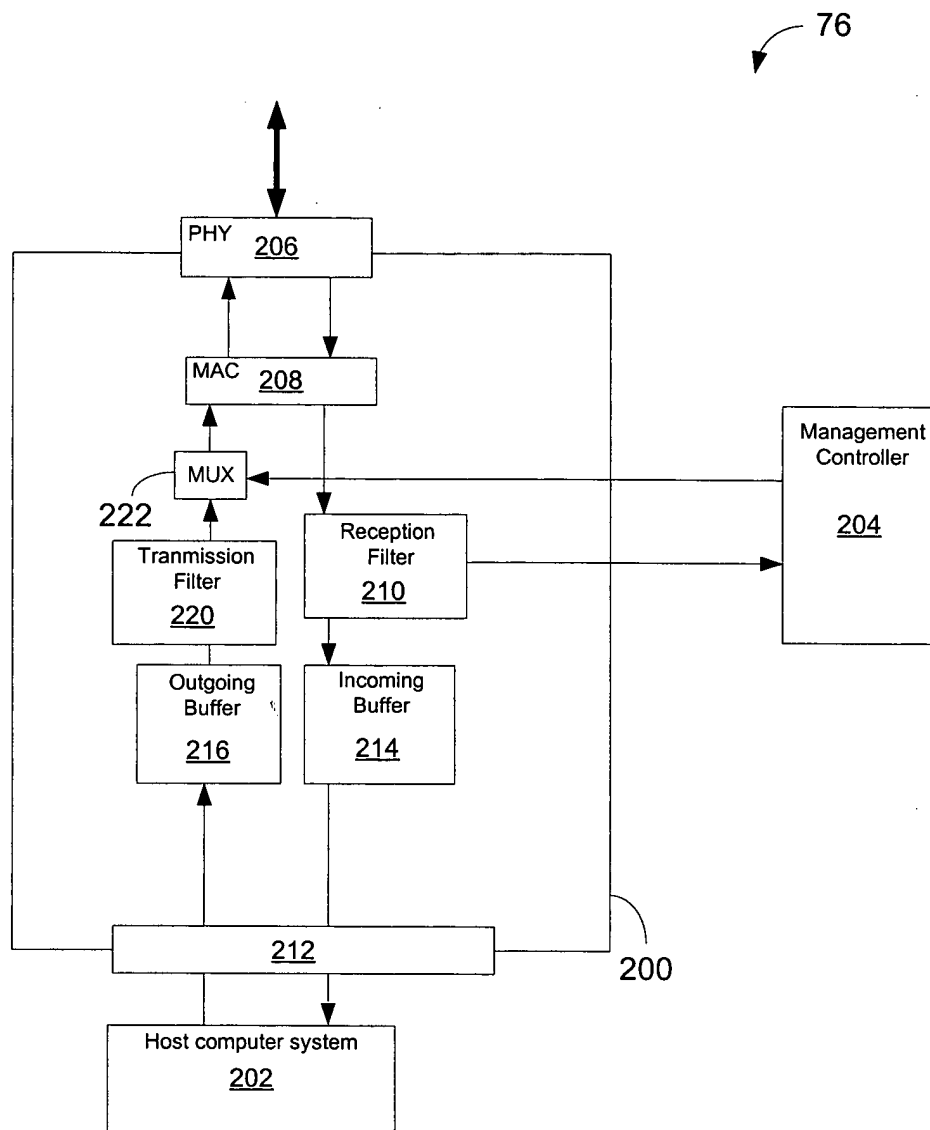
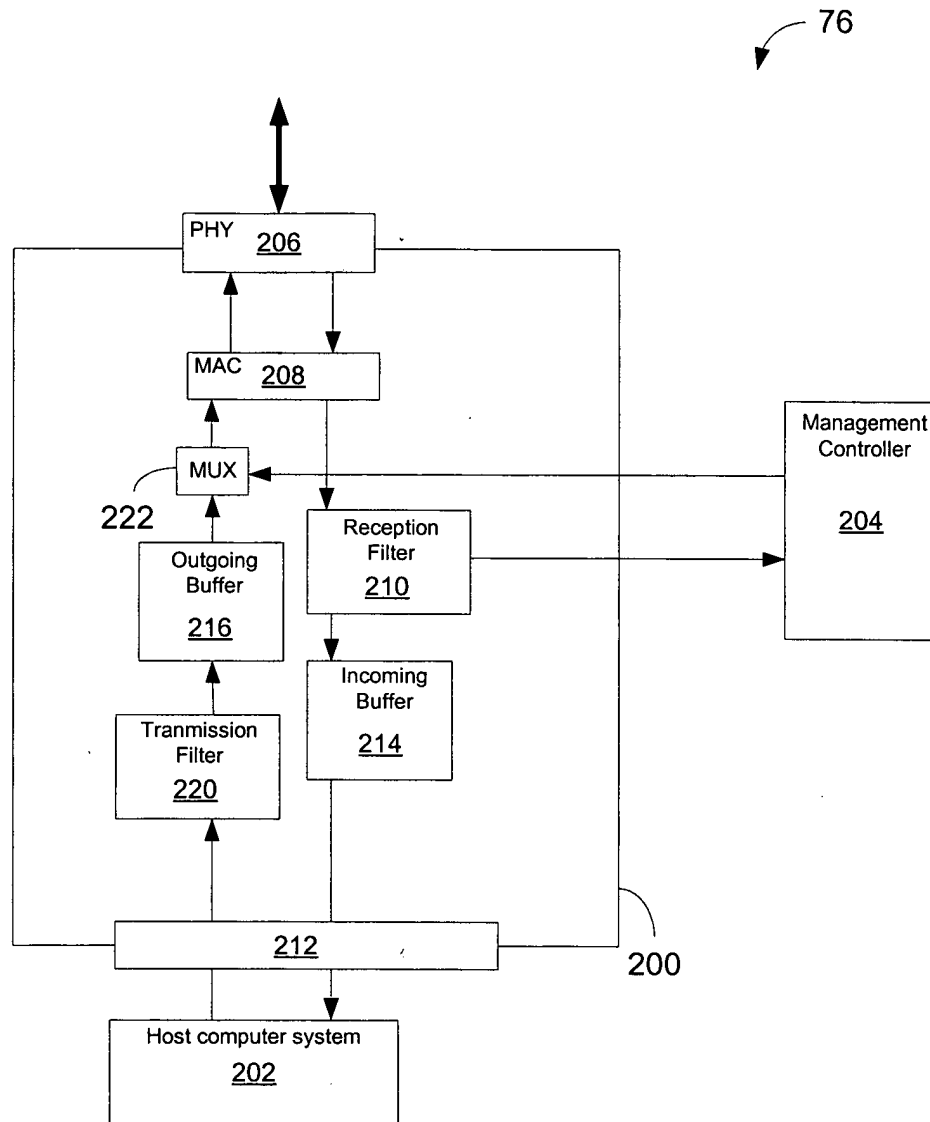


FIG. 2A



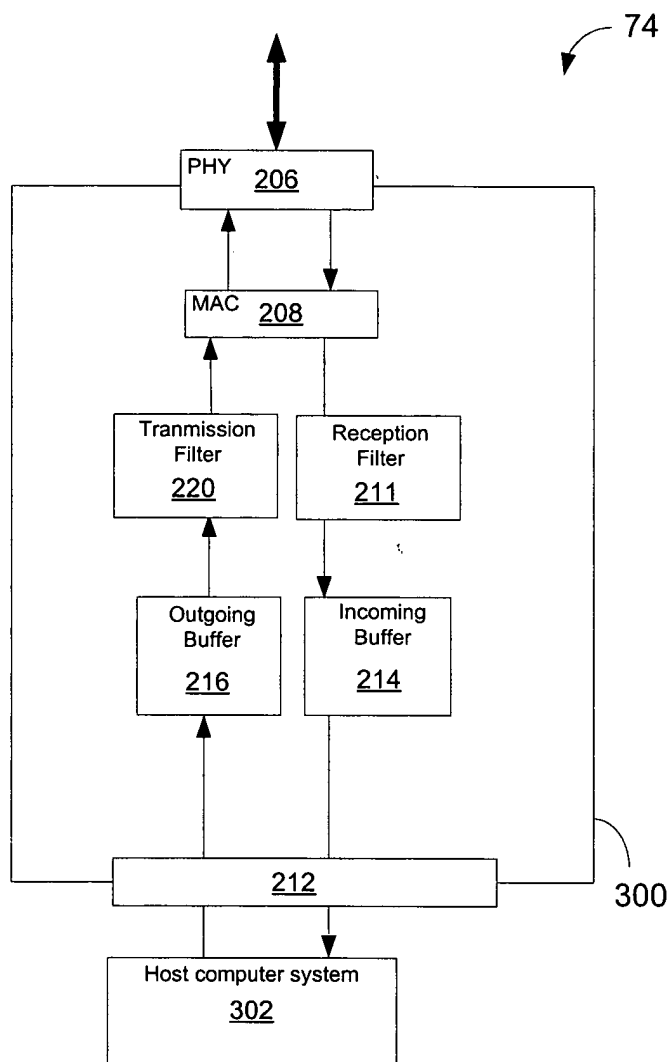


FIG. 3

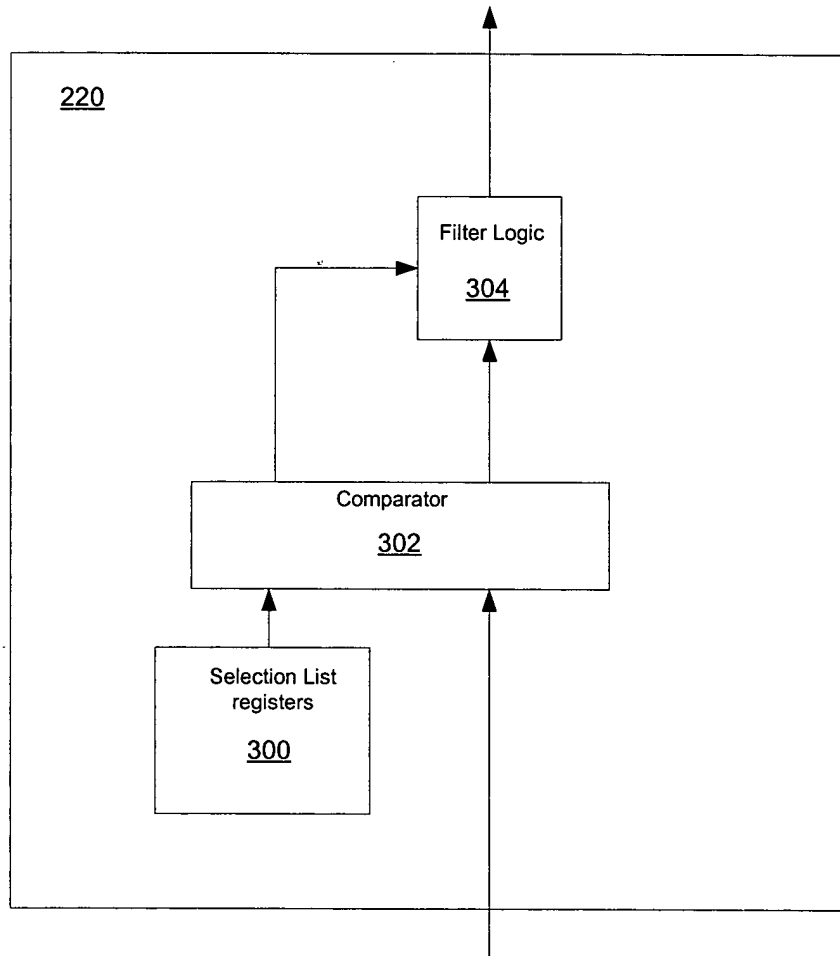


FIG. 4